



LTW UNIT HEATERS

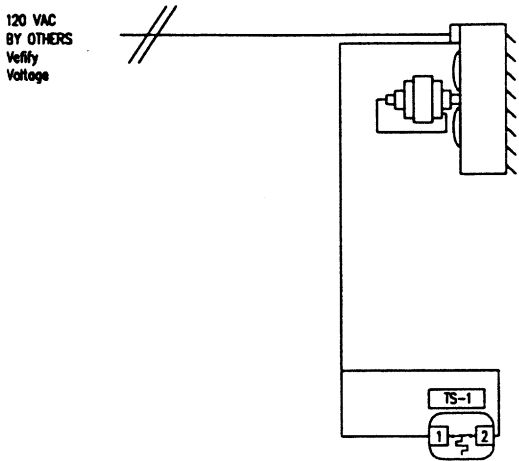

SEQUENCE OF OPERATIONS

Line voltage temperature switch, TS-1 will cycle unit heater fan to maintain a space setpoint of 65 F.(adjustable)

PNEUMATIC POWER

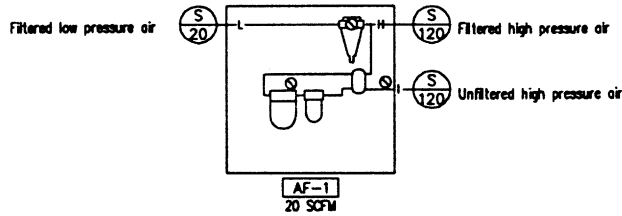

FIELD MATERIAL			
DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
AF-1	1	A-4000-141	FILTER STATION/ REDUCING
TS-1	27	T26A-14C	LINE VOLTAGE THERMOSTAT

ANY MATERIAL WITH A (P) PRECEEDING THE DEVICE TAG IS CONSIDERED PROPRIETARY EQUIPMENT AND IS BEING SUPPLIED BY JOHNSON CONTROLS, INC. ALL OTHER MATERIAL IS NON-PROPRIETARY EQUIPMENT.

DRAWING TITLE Unit Heater Control Installation		RECORD		06/08/94 SF	
Pneumatic Power supply		REFERENCE DRAWING NO. REVISION-LOCATION		ECN DATE BY	
PROJECT The Argonne National Labs Advanced Photon Source Campus 9700 Cass Avenue South Argonne, IL 60439		SALES ENGR PROJECT MGR/APPL ENGR JP SF DCS		DRAWN DATE 01/15/92 BY	
JOHNSON CONTROLS Systems & Services Division		3007 WALNUT ROAD ARLINGTON HEIGHTS ILLINOIS 60005 708/364-1500 Main 708/808-4438 Eng		CONTRACT NUMBER 91390-0009 DRAWING NUMBER 91-9-C-08A	